



Wednesday 17 June 2020

ASX:14D

TECHNOLOGY & COMMERCIAL REVIEW UPDATE

- Further R&D required to deliver higher efficiency TESS to raise commercial readiness level
- New development path mapped for long duration storage competitiveness
- Long term levelised cost of storage (LCOS) predictions are positive compared to other technologies

1414 Degrees can now report key findings of the technology review as foreshadowed in the last quarterly report.

There have been significant learnings since the 1414 Degrees Thermal Energy Storage System (TESS) was first demonstrated in the prototype in 2016 and then scaled up to build the TESS-IND and GAS-TESS pilot devices, the latter having now operated for more than a year. Over this time the Company has greatly increased its capability for technical management and development, appointing highly qualified materials and mechanical engineering specialists. Its business development team has gained valuable insight into commercialisation prospects by conducting numerous economic assessments of potential customer sites. Therefore, as Executive Chairman I recently commissioned reviews of the technical and commercial status and recommendations for future directions.

A key finding is that earlier expectations for sales of product were optimistic. Although the larger pilot TESS systems performed well in generating power for up to 8 hours and very efficiently charging from gas or electricity, key components of both the storage and energy recovery subsystems require significant development to deliver reliable performance, in particular:

- the prototype silicon storage technology could not sustain many cycles without degrading. In response to this challenge, 1414 Degrees operations management was refocused to work on developing a robust, scalable and energy dense storage technology for air and combustion environments. That work is progressing well.
- the third-party energy recovery system (ERS) could not perform to the required efficiency specifications. 1414 Degrees is working with external specialists and partners to deliver a commercially robust, high performance ERS.

The commercial review found that a fully developed electric charging TESS is not currently competitive with fossil fuel heating in most customer sites due to the higher input cost of electricity with transmission charges, even when the TESS is configured in its most efficient mode of storing electricity and supplying heat only.

With the experience gained from the pilot installations, our now highly qualified technical team has mapped out a path to make the 1414 Degrees TESS technology competitive in the expanding long duration energy storage market with comparable technologies such as pumped hydro and molten salt.

Following their wide-ranging customer assessments and surveys of growth markets, our business development team have identified major commercial opportunities for the TESS in the well-funded markets for long duration grid scale storage, and hybrid power plants. Further, in addition to preparing to service the utility market with the GAS-TESS, the commercial priority is to partner with utilities on large scale innovative energy solutions.

1414 DEGREES LTD
ABN 57 138 803 620

ADDRESS
10 Greenhill Road
Wayville SA 5034

PHONE
+61 8 8357 8273

EMAIL
info@1414degrees.com.au



Our new storage technology and ERS improvements can be proved in the GAS-TESS pilot device and followed at larger scale in the first stage of the Company's Aurora Project.

The 1-2 year revenue potential for the Company is to commence electricity sales from the first stage Aurora 70MW solar farm. The 2-5 year potential is expansion of the Aurora Project to generate 400MW from PV with TESS (Silicon Power Plant) to sell firmed power and grid strength services, and sales of improved GAS-TESS to global utilities.

Dr Kevin Moriarty
Executive Chairman

Major review results follow

TESS Technology Description

The TESS design has key sub-systems servicing a renewable power plant as illustrated in Figure 1. Other variations of the technology are the TESS-IND and GAS-TESS. The technical status and performance of each sub-system defines the overall TESS technology status and helps prioritise areas for further development.

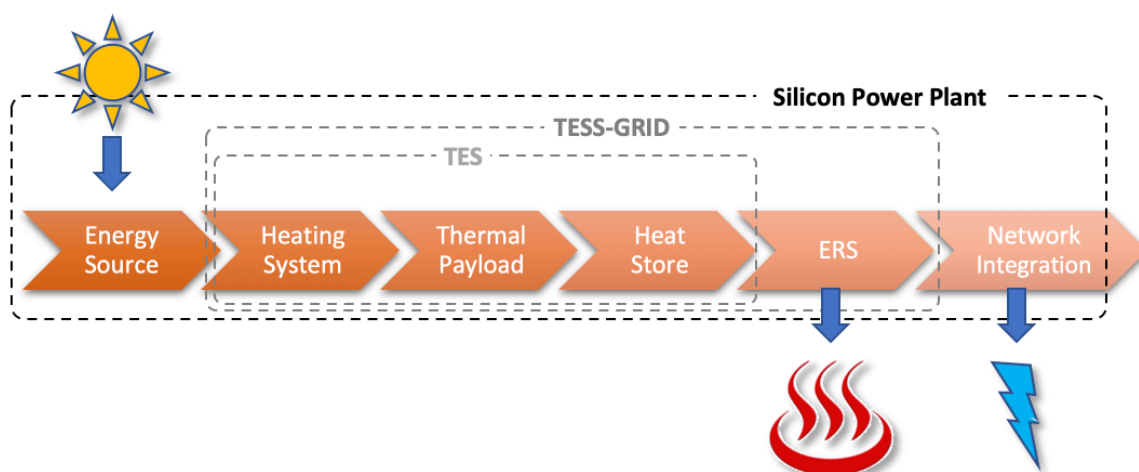


Figure 1: Energy flow via sub-systems for a complete Silicon (TESS-GRID) Power Plant

Key findings of the TESS Technology review are:

- **Technology Readiness:** The TESS requires further development work before it is commercially robust. That is, it should generally be considered at a Technology Readiness Level (TRL)* of 4-5 (Technology Development) with sub systems and a commercial readiness level (CRI)* of 1 -2:
 - Heating systems: TRL of 8 and highly efficient. The GAS-TESS burners delivered 83% efficiency compared to predicted 75%. Electrical TESS use nominally 100% efficient commercial elements.
 - Thermal payload: TRL 4. The prototype storage solution provided excellent heat transfer in the TESS-IND tests but was not robust nor scalable. A new 1414 Degrees silicon phase change storage technology that can operate in air with combustion products is producing very good test results and continues to demonstrate robustness.

- Energy Recovery System: TRL 5 because a high efficiency, turbine-based system is required for the TESS-IND and GAS-TESS. Note that the larger TESS-GRID device potentially has a higher TRL because commercial steam turbine based ERS systems are efficient at larger scale.
- The overall TRL is consistent with other electrically heated high temperature thermal energy storage technologies currently being commercialised around the world.
- **Energy Efficiency:**
 - The Thermal Energy Store (TES) efficiency is high with a theoretical upper limit of 98% for the thermal payload. The overall TES target is 95% efficiency but operationally will depend on run mode: continuous, short or long cycling
 - Combined Heat & Power (CHP) efficiency is variable depending on the heat offtake to the client process – a heat only supply could be 70% efficient. Heat with electricity efficiency depends on the ERS exhaust temperatures - some examples based on current TESS technology are:
 - Oil heat transfer fluid 325°C, 55% CHP
 - Saturated steam 180°C, 60% CHP
 - Hot water 80°C, 70% CHP
 - Net round-trip electrical efficiencies as demonstrated to date are low: prototype (2-3%), TESS-IND (6.8-16.8%) and GAS-TESS (0.1-3.0%)
 - The electrical efficiency of an electric charged TESS (TESS-GRID) is estimated to have an upper limit of 42%, with 35% practically achievable with available technologies
 - The upper limit of the GAS-TESS electrical efficiency is estimated to be 24%, for CHP of 65%.
- **Build cost:** currently, cost estimates are high for the heat store, thermal payload and ERS sub-systems, but will reduce with technical improvements and volume production.
- **Temperature advantage:** The higher temperature of the TESS provides advantages over molten salt thermal energy storage. In particular the operation of molten salt systems at temperatures below 600°C limits the ERS solutions that can be coupled with them. 1414 Degrees' TESS technology provides the flexibility to use next generation supercritical-CO2 turbines or ultra-supercritical steam turbines in future and at the same time supply high temperature heat (>800°C) for industrial use. A future TESS could be developed to provide ≥ 1000°C heat to drive thermochemical hydrogen production.
- **Development Pathways:** R&D priorities have been identified and robust R&D project plans prepared that will increase efficiency and decrease costs.

Key findings of the Commercial Review

- When fully developed the GAS-TESS will provide an integrated competitive solution for utilities seeking efficient biogas disposal and time shifting of energy value.
- The electrical charged TESS is most efficient when storing electricity and supplying heat only, but this is not competitive with fossil fuel heating in most customer sites without a significant emissions cost to defray the higher input cost of electricity.
- The economics of CHP supply to customers and the grid will improve with further reduction in TESS build costs and increasing payments for system strength services. The Aurora Project is well located to supply local customers and the NEM with power and services.
- There is a huge future market for energy storage - BloombergNEF estimate that the market for stationary energy storage will see a [122-fold increase by 2040](#). There are many solutions under development for long duration energy storage because it is a market for which batteries are not suitable. 1414 Degrees goal should be to have a commercially competitive storage solution able to compete in this market supplying power and high temperature heat.

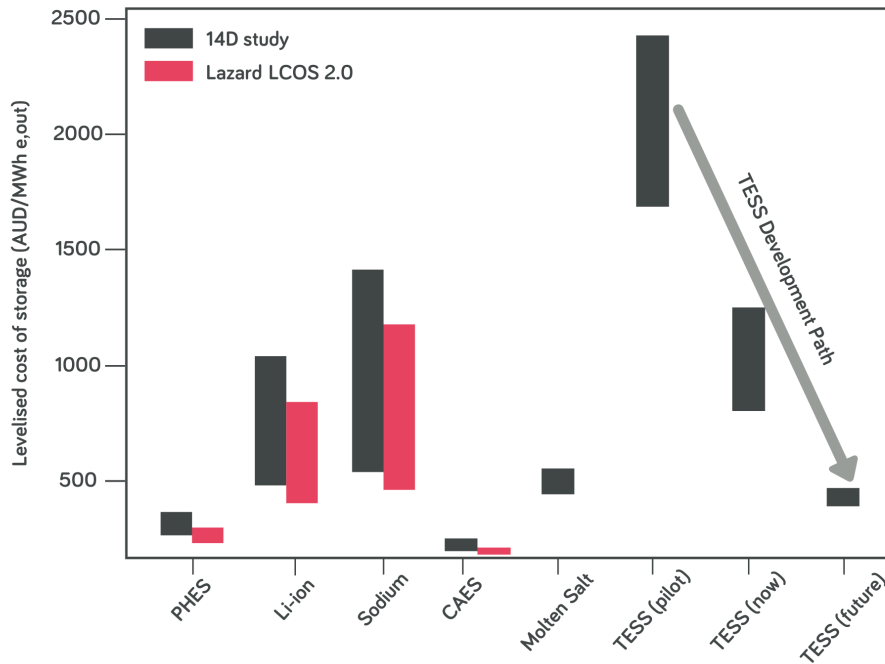



Figure 2: Levelised Cost of Storage prediction for TESS compared to other energy storage technologies.

- A fully developed, large scale TESS will have significant competitive advantage. Excluding heat value, our levelised cost of storage (LCOS) analysis (Figure 2) has shown that, on the basis of a standardised 100 MW-e output with 8 hours of storage and one cycle in a day, the successful delivery of proposed TESS R&D projects will deliver a TESS-GRID system with an LCOS of \$433-551/MWhe, which is lower than molten salts and competitive with large-scale pumped hydro.
- Grid scale energy storage is attracting substantial financial backing and since heat is currently relatively low value, 1414 Degrees should focus on bringing the technology to market readiness for:
 - Network utilities to use TESS storage for daily time-shifting of energy, with system strength and inertia
 - Power Stations & Utilities seeking to replace fossil fuels with thermal energy supplied from TESS storage to drive existing or new generation turbines
 - Larger off grid sites such as mines or countries with unreliable grids

Since TESS technology is forecast to be competitive with pumped hydro and substantially cheaper than lithium-ion for long duration energy storage over the next decade, and noting that the lead time for projects like Aurora is aligned with the TESS development schedule, the Commercial Review recommended that 1414 Degrees focus on:

- commercialisation for the larger scale or high temperature thermal energy markets and,
- seek further joint ventures with substantial partners and utilities who have an appetite for innovation, following the SA Water model.

*** Technology and Commercial Readiness Levels (TRL and CRI)**

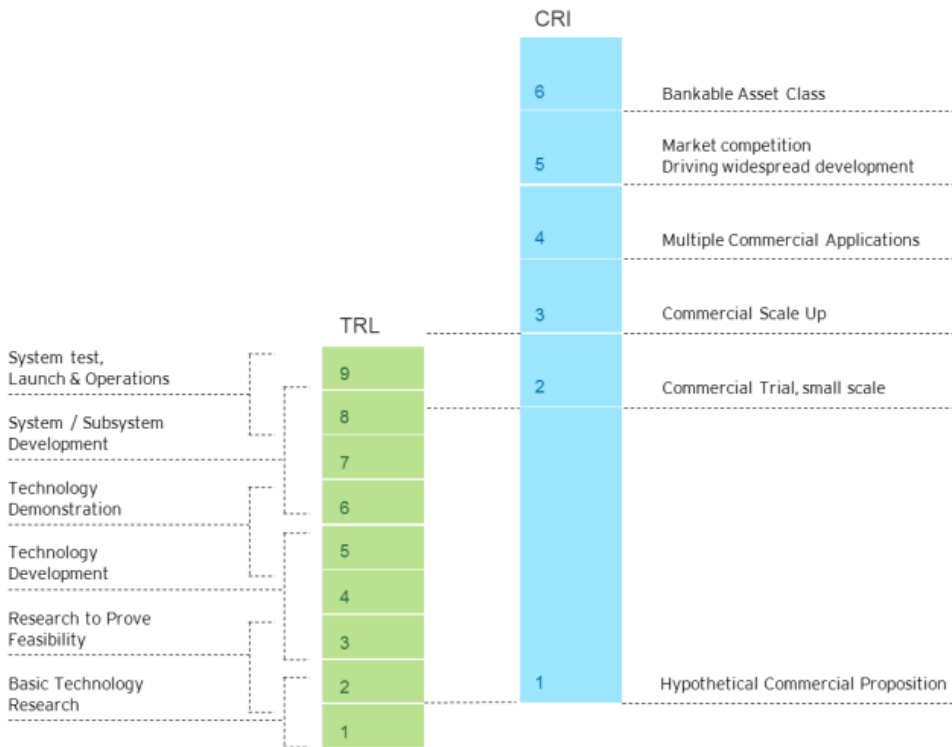

© Commonwealth of Australia (Australian Renewable Energy Agency) 2014

Source: <https://arena.gov.au/assets/2014/02/Technology-Readiness-Levels.pdf>

AUTHORISED BY:

Kevin Moriarty, Executive Chairman
+61 8 8357 8273

ABOUT 1414 DEGREES LIMITED

1414 Degrees believes in a sustainable energy future, where energy is available to all, at all times. Its clean energy storage is set to reduce energy costs by increasing the efficiency of renewable generation and stabilising grid supply. The 1414 Degrees thermal energy storage system (TESS) is unlike any other energy storage system in the world.

1414 Degrees’ technology stores energy generated from electricity or gas and supplies both heat and electricity in the proportions required by consumers. It is unique in its combination of low cost, flexibility of location, scalability, and sustainability. Following the successful development of its electrically charged TESS demonstrator, and commissioning of its pilot GAS-TESS at SA Water’s Wastewater Treatment Plant, the Company is now in an early stage of product development and commercialisation.

For more information please visit www.1414degrees.com.au